CYLINDER AG-TINDL-4-KBC

Pre-engineered fixed, automatic and self-contained detection (RG TRACE™) and dry chemical extinguishing system for piping networks / 4 kg / Stored pressure / Local application

Data sheet 13112 Rev.00


Product description

The AG-TINDL-4-KBC dry chemical cylinders are designed for pre-engineered fixed, automatic and self-contained detection and extinguishing systems, which operate with a predefined piping network and a fixed quantity of agent — in this case, 4 kg of extinguishing agent.

Dry chemical systems are suitable for the protection of Class A hazards (combustible solid materials), Class B hazards (flammable liquids and gases), and Class C hazards (energized electrical equipment).

The system consists of a cylinder filled with dry chemical powder, connected to the RG TRACE™trace-NT heat detection tubing, which is installed along the area to be protected in order to detect a fire and automatically activate the system. The cylinder is also connected to a piping network that distributes the agent to the local application nozzle. The cylinder is pressurized with the propellant agent (N_2) at 15 bar and, in addition to automatic activation via the heat detection tubing, it can include manual and electrical activation methods (optional). Once activated, the system discharges the extinguishing agent and distributes it over the protected area through the nozzle.

System components

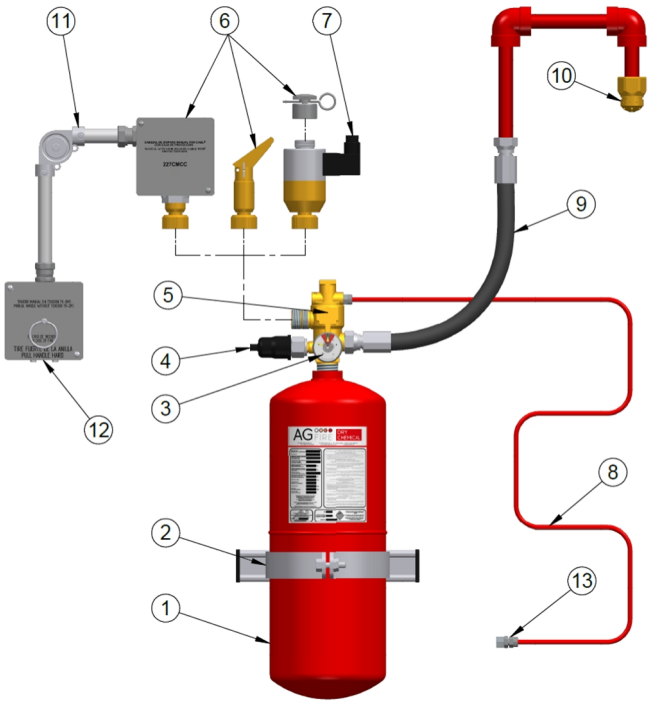

Nº	Description	Type	Qty
1	Cylinder	TINDL-4-KBC	1
2	Fixing Brackets	POHCxxx	1
3	Pressure Gauge	5140-W25, 5140-W40, UF40I-P16, UF40I-P24	1
	Pressure Gauge with electrical contacts (optional)	5140-E40SP13, UF40I-E16, UF40I-P24	
4	Pressure switch (optional)	POPRENA20, POPRENC20, POPRENA50, POPRENC50, APRESA20, APRESC20, APRESA50, APRESC50	1
5	Container valve	RGS-MAM-12-FD1	1
6	Manual actuator	227DM, 227DMS, 227CMCC, 227CMC, 227CNTK, 227CN, 227CNM	1
7	Electrical actuator (optional)	227SOL, 227SOLC, 227SOLC125	
8	Heat detection tubing	RG TRACE™-NT	1
9	Discharge hose ½"	FH-15CO, DH-15, DH-15 I, DH-16, DH-16 I	1
10	Nozzle	AG-O-2, AG-TK-1	1
11	Pulley elbow	TK-CPx	-
12	Remote manual pull station	TK-DMS, TK-DMS2	-
13	End of line	ST-FL1-Ø6, ST-FL3-Ø3, ST-FL3-10, ST-FL4-10	1
	Closure cap	ST-FC1-Ø6, ST-FC2- Ø6	

Applications


Pre-engineered dry chemical cylinders are designed for a wide range of industrial applications, including paint booths and preparation areas, coating and finishing operations, machinery and equipment areas, boiler rooms, furnaces, and electrical and mechanical rooms, as well as facilities for the storage of flammable liquids, hazardous materials, and bulk products, spill containment dikes, and quench and dip tanks.

Technical data

STORED PRESSURE DRY CHEMICAL CYLINDER					
Model type	**Dry chemical filling lbs (kg)**	**Cylinder pressure psi (bar)**	**Risk type**	**Dry chemical type**	**Number of nozzles**
TINDL-4-KBC	8.8 (4)	218 (15)	Local Application	KBC	1

C/Alfoz de Bricia nº4 | P.I. Villalonquéjar | 09001 Burgos (Spain) | Tlfno: +34 947 28 11 08 | www.agfiresprinkler.com

Dimensions

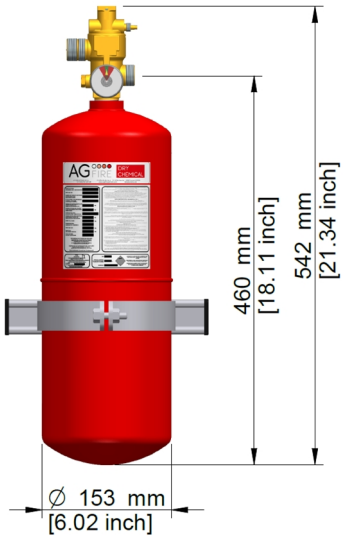


APPROXIMATE DIMENSIONS

Pressure switch (optional)

The pressure switch is a monitoring device that sends an electrical signal to the fire control panel when the pressure in the cylinder drops.

It is factory-supplied preassembled on the cylinder valve, in the corresponding port. Inside the device, there is a dry contact that opens or closes an electrical circuit depending on the pressure condition. There are two variants available: NC (normally closed, opens under pressure) and NO (normally open, closes under pressure).

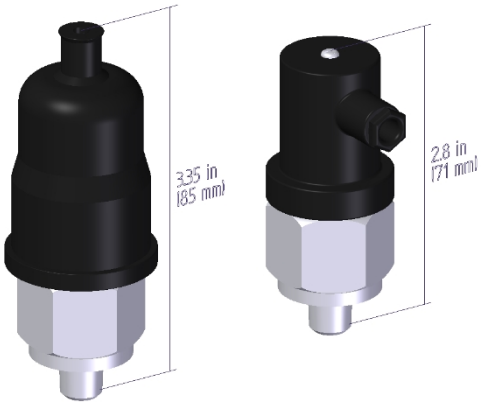

POPRENxxx APRESxxx

RG TRACE™-NT heat detection tubing


The RG TRACE™ tubing is a heat-sensitive tube designed to rupture at a predetermined temperature.

The pressurized tube is installed along the hazard area and ruptures when a temperature increase caused by a fire occurs. Depressurization of the tube activates the cylinder valve, allowing the extinguishing agent to be discharged through the nozzles.




ST-FLx-xx end of line

The ends of line are installed at the end of the RG TRACE™ tubing and are used to monitor its pressure by visual indication (pressure gauges), visual indication with pressure drop alarm signal (pressure gauges with electrical contacts) or monitor pressure drop warning (pressure switch).

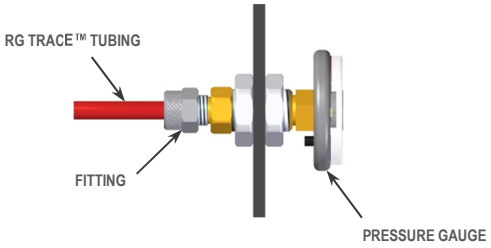

ST-FL1-Ø6 end of line with actuator

Besides pressure monitoring, the ST-FL1-Ø6 end of line enables the installation of actuators to activate the system either manually or electrically.

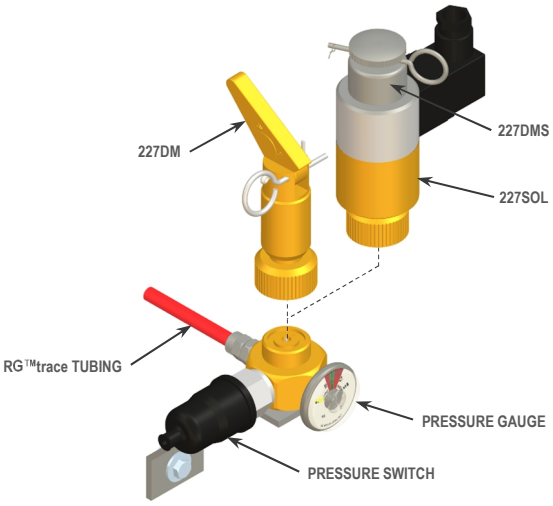

Electrical activation (optional)


227SOL resettable electric actuator head (24VDC)

The purpose of this actuator is to electromagnetically actuate the container valves where it is installed. It is activated when the coil is energized, causing the solenoid to operate and actuate the valve.

This actuator is resettable — the pin returns to the standby position by threading a reset screw into its revolving nut.

The mechanism used to connect it to the container valve includes a revolving nut, allowing it to be properly oriented in the desired direction.

If installation conditions require special protection, please contact AG-IND to inquire about the availability of appropriately rated enclosures.

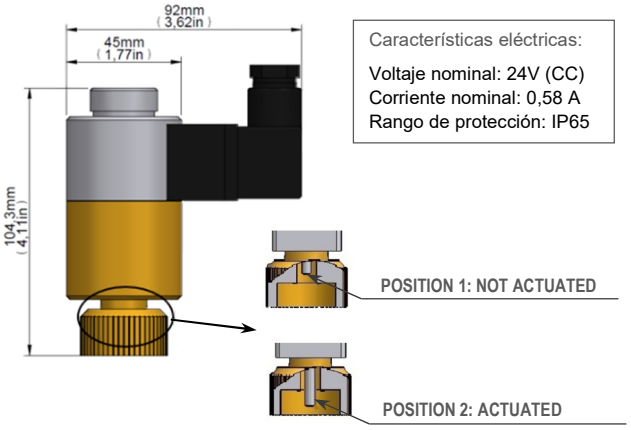

Características eléctricas:

Voltaje nominal: 24V (CC)
Corriente nominal: 0,58 A
Rango de protección: IP65


C/Alfoz de Bricia nº4 | P.I. Villalonquéjar | 09001 Burgos (Spain) | Tlfno: +34 947 28 11 08 | www.agfiresprinkler.com

Manual activation

227DMS manual actuator head

This actuator allows manual activation of the container valves where it is installed. Once the safety pin is removed from the actuator, the push button can be pressed to activate the container valve and initiate discharge.

The 227DMS is connected ONLY to the upper actuation port of the 227SOL, 227SOLC, and 227SOLC125 electric actuators, by means of a revolving nut that allows its proper orientation.

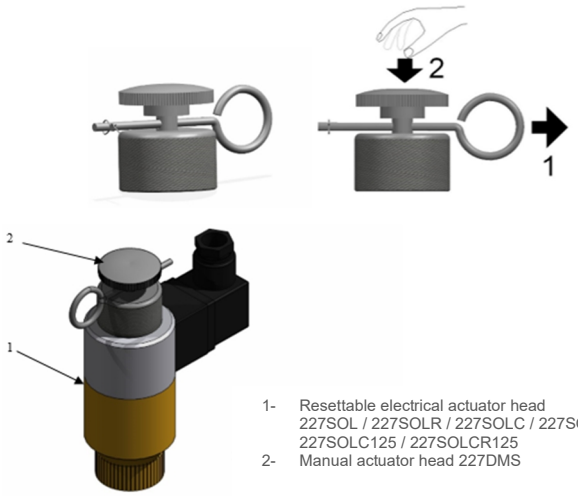


1- Resettable electrical actuator head 227SOL / 227SOLR / 227SOLC / 227SOLCR / 227SOLC125 / 227SOLCR125
2- Manual actuator head 227DMS

227DM manual actuator head

The function of this actuator is to manually activate the container valves where it is installed. Once the safety ring is removed from the actuator, the manual lever can be turned in the opposite direction.

The 227DM manual actuator can be installed on the side actuation port of the RGS-MAM-12-FD1 valve, or mounted on top of the electric actuator installed on that valve, using a revolving nut that allows proper orientation.

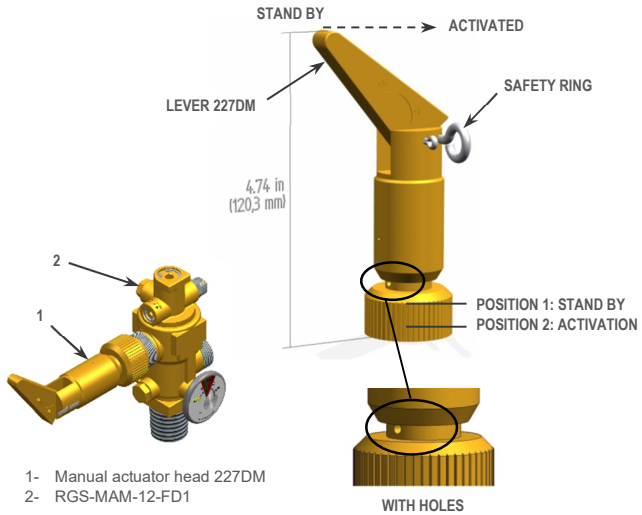


1- Manual actuator head 227DM
2- RGS-MAM-12-FD1

227CMC manual cable-operated actuator head and 227CMCC with protective box

It is used to remotely actuate the extinguishing system. This manual cable-operated actuator head actuator can be installed on the side actuation port of the RGS-MAM-12-FD1 valve, or mounted on top of the electric actuator installed on that valve, and is connected by cable inside a conduit (protective pipe) to the remote manual pull station.

The lever end includes a hole to tie the cable. The only difference between the 227CMC and 227CMCC models is that the latter (227CMCC) is housed inside a protective enclosure.


The cable is installed inside a steel pipe, using pulley elbows (TK-CPx) that allow for the directional changes required by obstacles and the elevation variations needed to reach the 227CMC or 227CMCC manual cable-operated actuator head.

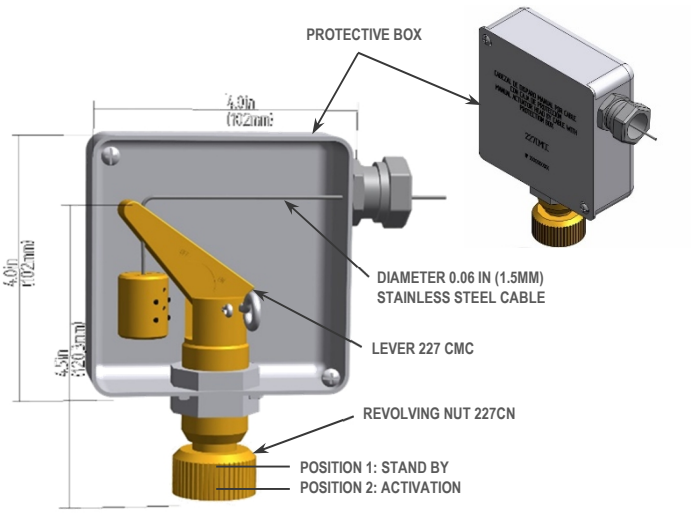

TK-CPx pulley elbow

The pulley elbow is installed as part of the manual cable-operated actuator head and provides a change of direction with minimal force loss due to friction. Its function is to drive the stainless steel cable to avoid obstacles through the necessary directional changes to connect the remote manual pull station without tension (TK-DMS) with the 227CMC or 227CMCC manual cable actuator.

In addition, it connects the detection kits with the mechanical control unit and with all components that operate using detection cable. It contains a small internal bearing to guide the cable and completely eliminate friction.

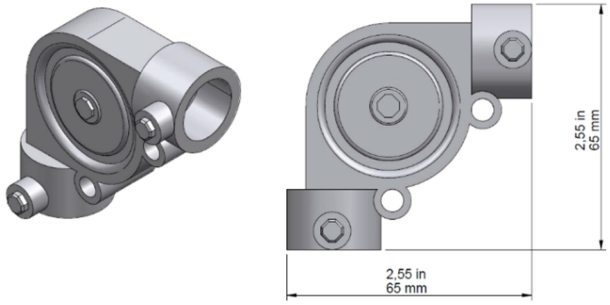

ALL ACTUATORS AVAILABLE FOR RGS-MAM-12-FD1 CONTAINER VALVES AND THE ST-FL1-Ø6 END OF LINE ARE SHOWN ON PAGE 5.

C/Alfoz de Bricia nº4 | P.I. Villalonquéjar | 09001 Burgos (Spain) | Tlfno: +34 947 28 11 08 | www.agfiresprinkler.com

Nozzles

Its function is to discharge the extinguishing agent into the protected area as homogeneously as possible to achieve effective suppression. With the AG-TINDL-4-KBC dry chemical cylinders, one nozzle is installed, which model depends on the application:

AG-O-2 local application nozzle

Designed for local application fire protection systems, it is threaded onto the discharge pipe in a vertical position.



AG-TK-1 local application nozzle

Developed for the protection of flammable liquid storage tanks or to cover by immersion areas prone to flammable liquid spills. It is installed next to the tank and discharges at a 90º angle to the piping, creating a flat semicircular chemical blanket over the surface of the flammable liquid.





ⓘ **This document provides a simplified overview of the most common system components. For further information, please contact AG FIRE SPRINKLER.**

C/Alfoz de Bricia nº4 | P.I. Villalonquéjar | 09001 Burgos (Spain) | Tlfno: +34 947 28 11 08 | www.agfiresprinkler.com

Actuator configuration

There is a wide range of actuators available depending on the requirements, as a complement to activation via the RG TRACE™ heat detection tubing. All have the same function: to activate the dry chemical stored-pressure cylinder, and they can be installed either on the cylinder valve or at the end of the line. Typically, the system is fitted with a 227DM actuator head on the end of the line.

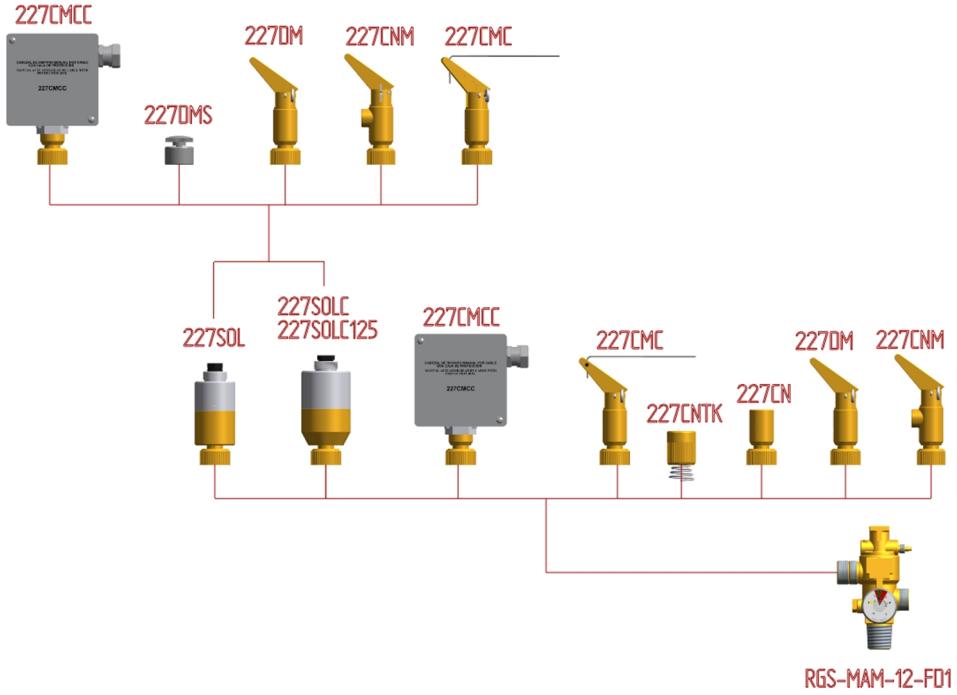

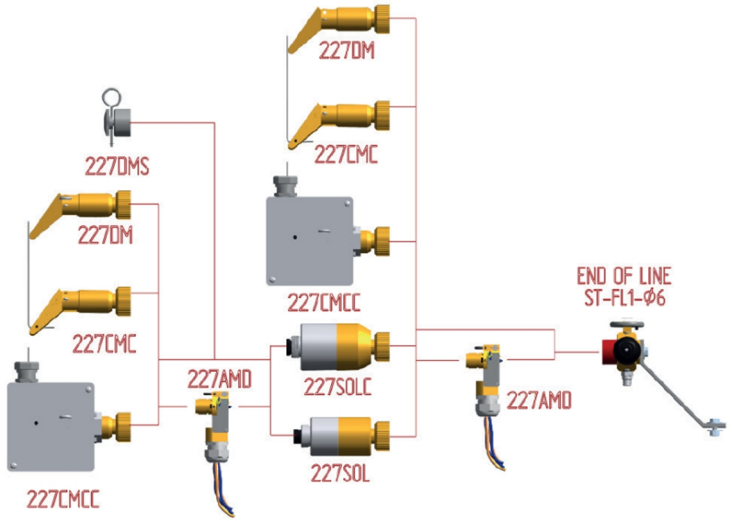

WARNING: This type of system is manufactured and approved for use in fixed dry chemical extinguishing installations. These products are not designed for any other use or purpose. If the product user has any questions regarding the application or use of the product, please contact +34 947 28 11 08. Any unauthorized use or application and/or any other unauthorized modification of the product or its function may cause serious accidents and/or personal injury. AG Fire is not responsible for any unauthorized use of the application.

IMPORTANT: This document is not binding. AG Fire Sprinkler reserves the right to make any changes to the document without prior notice.

C/Alfoz de Bricia nº4 | P.I. Villalonquéjar | 09001 Burgos (Spain) | Tlfno: +34 947 28 11 08 | www.agfiresprinkler.com