# GA SERIES / MODEL GA-56

## Standard Coverage / High Pressure Sprinkler
## Standard Response Sprinkler
## Recessed Pendent, Pendent & Upright

c UL us
EX15331



Recessed Pendent



Pendent



Upright

## PRODUCT DESCRIPTION

AG Fire Sprinkler Model GA-56 High Pressure, Pendent and Upright sprinklers described in this technical data sheet are standard response, standard coverage 5mm glass bulb. These sprinklers are designed for use in commercial occupancies such as hotels, banks, shopping malls, and factories.

Thermosensitive glass bulb 5mm is used. The bulb contains a special liquid hermetically sealed in a glass capsule.

## TECHNICAL DATA

| | |
|---|---|
| **Nominal "K" Factor** | 5.6 (80 metric) |
| **Thread Size** | 1/2" NPT |
| **Temperatures** | 135ºF (57ºC)<br>155ºF (68ºC)<br>175ºF (79ºC)<br>200ºF (93ºC)<br>286ºF (141ºC)<br>360ºF (182ºC) |
| **Maximum Working Pressure** | 300psi (21bar) |
| **Materials** | Frame: Brass Alloy<br>Deflector: Cooper Alloy<br>Screw: Brass Alloy<br>Bulb Seat: Copper Alloy<br>Sealing Spring: Nickel Alloy<br>Bulb: Glass, 5mm size |
| **Reference** | Pendent: **GA5652**<br>Upright: **GA5662** |
| **Finish**[1] | Bronze<br>Chrome<br>Polyester |

1. Other Finishes available under request.

## OPERATION

At normal temperatures, the glass bulb contains the fluid in both the liquid phase and the vapor phase. The vapor phase can be seen as a small bubble. As heat is applied, the liquid expands forcing the bubble smaller and smaller as the liquid pressure increases. Continued heating forces the liquid to push out against the bulb, causing to shatter, opening the waterway and allowing the deflector to distribute the discharging water.



*C/Alfoz de Bricia nº4 | P.I. Villalonquéjar | 09001 Burgos (Spain) | Tlfno: +34 947 28 11 08*

## INSTALLATION

Model GA-56 High Pressure sprinklers are standard response sprinklers intended for installation as specified in NFPA13. They must also be installed with the Model **AB** or **CO1** Sprinkler Wrench specifically designed by AG Fire Sprinkler for use with these sprinklers.

A leak tight ½" NPT (R1/2) sprinkler joint can be obtained with a torque of 8-18ft-lbs (10.8-24.4N-m). Do not tighten sprinklers over maximum recommended torque. It may cause leakage or impairment of these sprinklers.


The sprinklers come with an orange protection, to avoid breakage during assembly. Remove this protection once installed and made sure that everything is correct. The AG Sprinkler Wrenches are designed to install sprinklers with the protection still.

**Note: Installation with overpressure above the housing is not permitted.**

## TEMPERATURE RATINGS

| Classification | Sprinkler Temperature | | Max. Ambient Temperature | | Bulb Color |
|---|---|---|---|---|---|
| | ºF | ºC | ºF | ºC | |
| Ordinary | 135 | 57 | 100 | 38 | Orange |
| Ordinary | 155 | 68 | 100 | 38 | Red |
| Intermediate | 175 | 79 | 150 | 66 | Yellow |
| Intermediate | 200 | 93 | 150 | 66 | Green |
| High | 286 | 141 | 225 | 107 | Blue |
| High | 360 | 182 | 225 | 107 | Mauve |

## DIMENSIONS

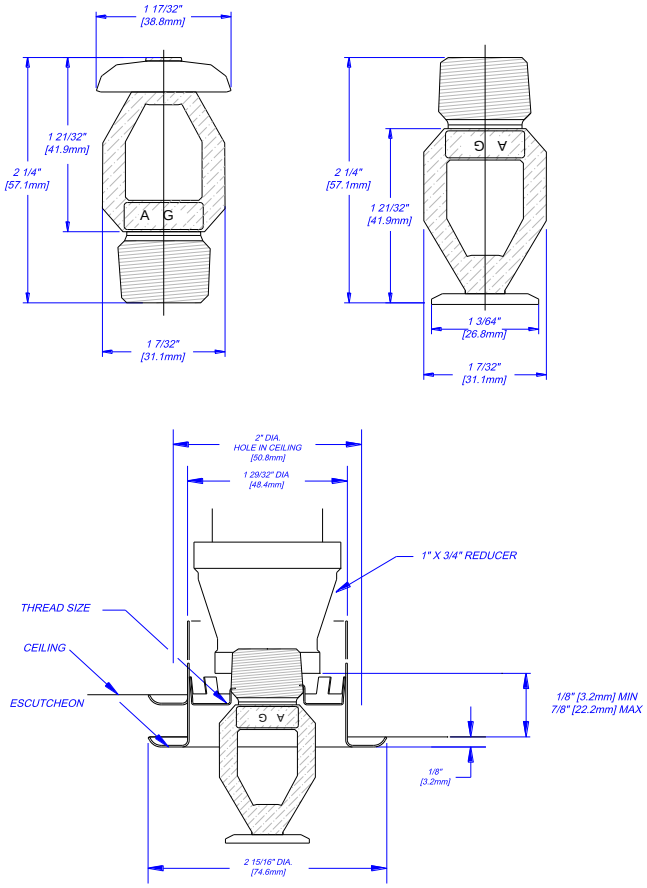



C/Alfoz de Bricia nº4 | P.I. Villalonquéjar | 09001 Burgos (Spain) | Tlfno: +34 947 28 11 08

## ORDERING INFORMATION

| P/N | GAXXXX Y Z |
|---|---|

| DESCRIPTION | CODE |
|---|---|
| Pendent | GA5652 |
| Upright | GA5662 |

| | | | |
|---|---|---|---|
| Y | **1** | 57ºC | 135ºF |
| | **2** | 68ºC | 155ºF |
| | **4** | 79ºC | 175ºF |
| | **5** | 93ºC | 200ºF |
| | **7** | 141ºC | 286ºF |
| | **8** | 182ºC | 360ºF |

| | | |
|---|---|---|
| Z | **1** | BRASS |
| | **2** | CHROME |
| | **3** | WHITE RAL9003 |

Specify:

| | |
|---|---|
| Quantity | |
| Model Number | |
| Type | |
| Orifice | |
| Thread Size | |
| Temperature | |
| Finishes | |
| Quantity - Wrenches | |



*C/Alfoz de Bricia nº4 | P.I. Villalonquéjar | 09001 Burgos (Spain) | Tlfno: +34 947 28 11 08*

## AG FIRE SPRINKLER

AG Fire Sprinkler offers a wide selection of components. Then a list of products is presented by AG Fire Sprinkler, we can offer all these components, made with precision to protect people, anywhere, anytime.

- Sprinklers
  - Standard Coverage
  - Extended Coverage
  - Storage
  - Dry
  - Accessories
- System Valves
  - Wet
  - Dry
  - Preaction Equipment
  - Accessories
- Spray System Open Nozzles
  - High Velocity Nozzles
  - Medium Velocity Nozzles
  - Window Nozzles
  - Hydroshield Nozzles
  - Mushroom Type Nozzles
- Foam equipment
  - Tanks
  - Proportioners
  - Foam Discharge Equipment
  - Foam Concentrates
- Deluge equipment for Water Spray and Foam
  - Clapper Deluge Valves
  - Diaphragm Deluge Valves
- Monitors
  - Manual Monitors
  - Remote Monitors
  - Monitor Nozzles
  - Towers and Trolleys
- Valves
  - Butterfly Valves
  - Gate Valves
  - Check Valves
  - Pressure Control Valves
  - Test and Drain
  - Hose, Hydrant and Fire Connection Valves
  - Fire Department Connections

The equipment presented in this bulletin is to be installed in accordance with the latest published Standard of the National Fire Protection Association, Factory Mutual Research Corporation, or other similar organizations and also with the provisions of governmental codes or ordinances whenever applicable.
This documentation is not contractual. AG Fire Sprinkler reserves the right to any kind of change without notice.



*C/Alfoz de Bricia nº4 | P.I. Villalonquéjar | 09001 Burgos (Spain) | Tlfno: +34 947 28 11 08*